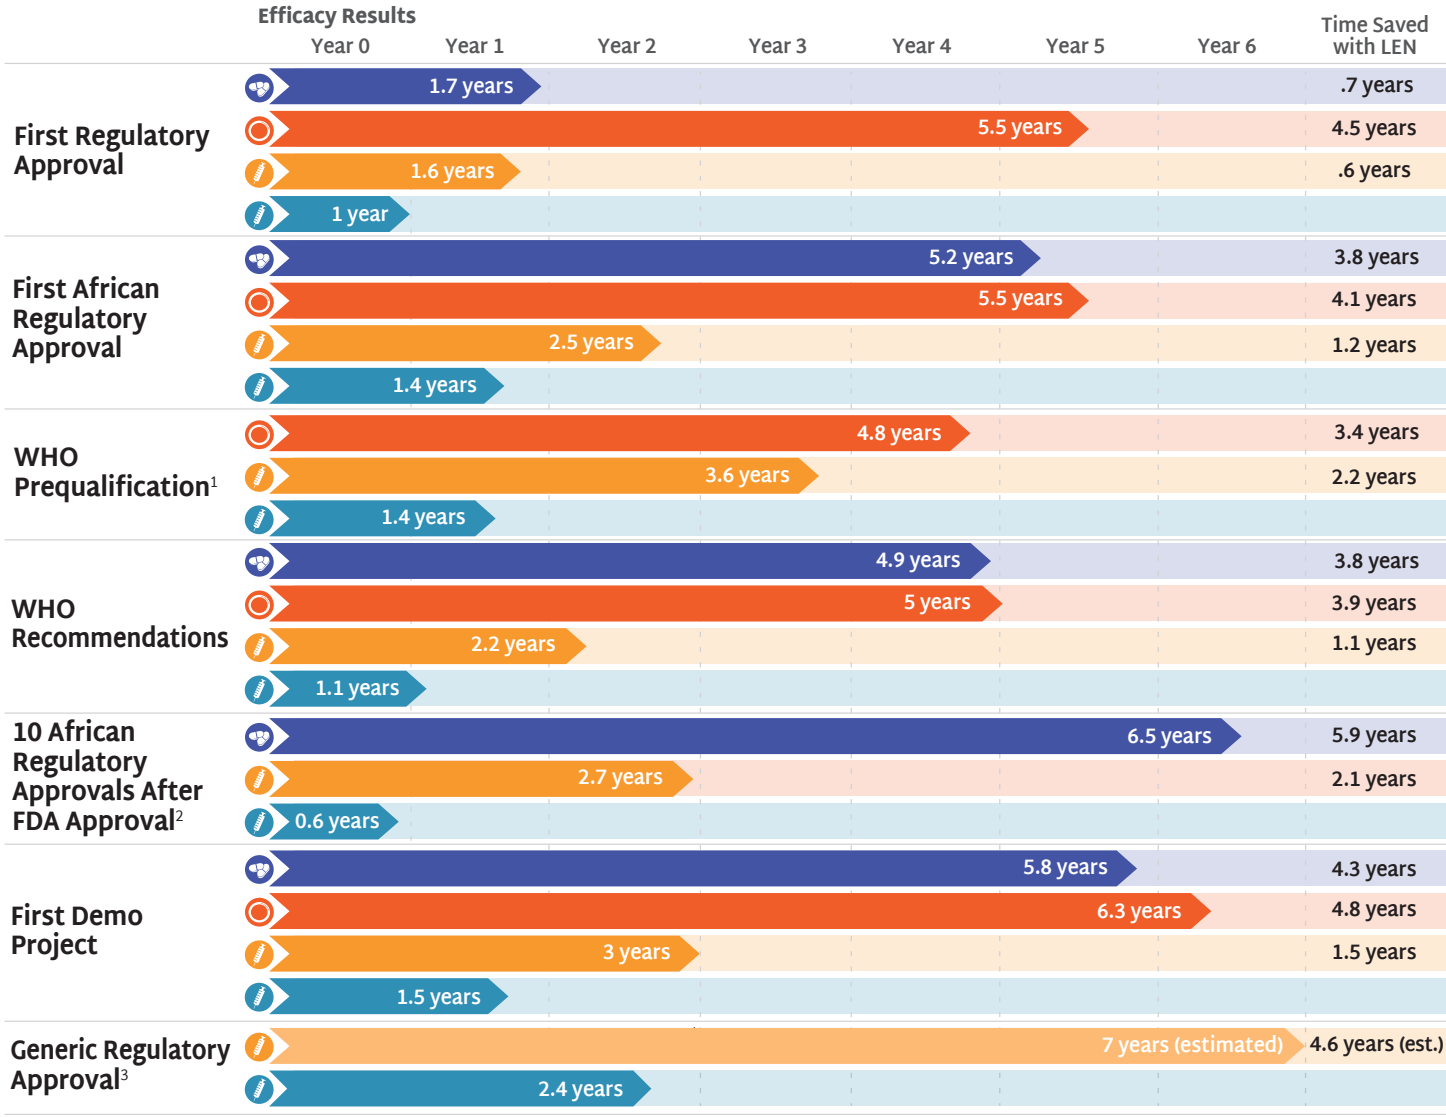


1 Oral TDF/FTC was already approved for treatment; additional WHO pre-qualification was not required.

2 DVR was not approved by the FDA and therefore regulatory approvals cannoot be compared to FDA approval.

3 Generic oral TDF/FTC was already approved for treatment; generic DVR not currently planned.

AVAC Advocacy. Access. Equity. Project Bridge

November 2026